



CONCRETE PORCHES



Application for a Permit to Construct or Demolish

This form is authorized under subsection 8(1.1) of the *Building Code Act, 1992*

For use by Principal Authority			
Application number:		Permit number (if different):	
Date received:		Roll number:	
Application submitted to: <u>Town of Ajax</u>			
A. Project information			
Building number, street name		Unit number	Lot/con.
Municipality	Postal code	Plan number/other description	
Project value est. \$		Area of work (m ²)	
B. Purpose of application			
<input type="checkbox"/> New construction <input type="checkbox"/> Addition to existing building <input type="checkbox"/> Alteration/repair <input type="checkbox"/> Demolition <input type="checkbox"/> Conditional permit			
Proposed use of building		Current use of building	
Description of proposed work			
C. Applicant			
Applicant is: <input type="checkbox"/> Owner or <input type="checkbox"/> Authorized agent of owner			
Last name	First name	Corporation or partnership	
Street address		Unit number	Lot/con.
Municipality	Postal code	Province	E-mail
Telephone number ()	Fax ()	Cell number ()	
D. Owner (if different from applicant)			
Last name	First name	Corporation or partnership	
Street address		Unit number	Lot/con.
Municipality	Postal code	Province	E-mail
Telephone number ()	Fax ()	Cell number ()	


This content is available in alternative formats upon request by contacting 905-683-4550 or emailing contactus@ajax.ca.

E. Builder (optional)				
Last name		First name	Corporation or partnership (if applicable)	
Street address			Unit number	Lot/con.
Municipality		Postal code	Province	E-mail
Telephone number ()		Fax ()	Cell number ()	
F. Tarion Warranty Corporation (Ontario New Home Warranty Program)				
i. Is proposed construction for a new home as defined in the <i>Ontario New Home Warranties Plan Act</i> ? If no, go to section G.			<input type="checkbox"/> Yes	<input type="checkbox"/> No
ii. Is registration required under the <i>Ontario New Home Warranties Plan Act</i> ?			<input type="checkbox"/> Yes	<input type="checkbox"/> No
iii. If yes to (ii) provide registration number(s): _____				
G. Required Schedules				
i) Attach Schedule 1 for each individual who reviews and takes responsibility for design activities.				
ii) Attach Schedule 2 where application is to construct on-site, install or repair a sewage system.				
H. Completeness and compliance with applicable law				
i) This application meets all the requirements of clauses 1.3.1.3 (5)(a) to (d) of Division C of the Building Code (the application is made in the correct form and by the owner or authorized agent, all applicable fields have been completed on the application and required schedules, and all required schedules are submitted). Payment has been made of all fees that are required, under the applicable by-law, resolution or regulation made under clause 7(1)(c) of the <i>Building Code Act, 1992</i> , to be paid when the application is made.			<input type="checkbox"/> Yes	<input type="checkbox"/> No
ii) This application is accompanied by the plans and specifications prescribed by the applicable by-law, resolution or regulation made under clause 7(1)(b) of the <i>Building Code Act, 1992</i> .			<input type="checkbox"/> Yes	<input type="checkbox"/> No
iii) This application is accompanied by the information and documents prescribed by the applicable by-law, resolution or regulation made under clause 7(1)(b) of the <i>Building Code Act, 1992</i> which enable the chief building official to determine whether the proposed building, construction or demolition will contravene any applicable law.			<input type="checkbox"/> Yes	<input type="checkbox"/> No
iv) The proposed building, construction or demolition will not contravene any applicable law.			<input type="checkbox"/> Yes	<input type="checkbox"/> No
I. Declaration of applicant				
I _____ declare that: (print name)				
1. The information contained in this application, attached schedules, attached plans and specifications, and other attached documentation is true to the best of my knowledge.				
2. If the owner is a corporation or partnership, I have the authority to bind the corporation or partnership.				
_____ Date		_____ Signature of applicant		

Personal information contained in this form and schedules is collected under the authority of subsection 8(1.1) of the *Building Code Act, 1992*, and will be used in the administration and enforcement of the *Building Code Act, 1992*. Questions about the collection of personal information may be addressed to: a) the Chief Building Official of the municipality or upper-tier municipality to which this application is being made, or, b) the inspector having the powers and duties of a chief building official in relation to sewage systems or plumbing for an upper-tier municipality, board of health or conservation authority to whom this application is made, or, c) Director, Building and Development Branch, Ministry of Municipal Affairs and Housing 777 Bay St., 2nd Floor. Toronto, M5G 2E5 (416)585-6666.

This content is available in alternative formats upon request by contacting 905-683-4550 or emailing contactus@ajax.ca.

Application for a Permit to Construct or Demolish – Effective January 1, 2014

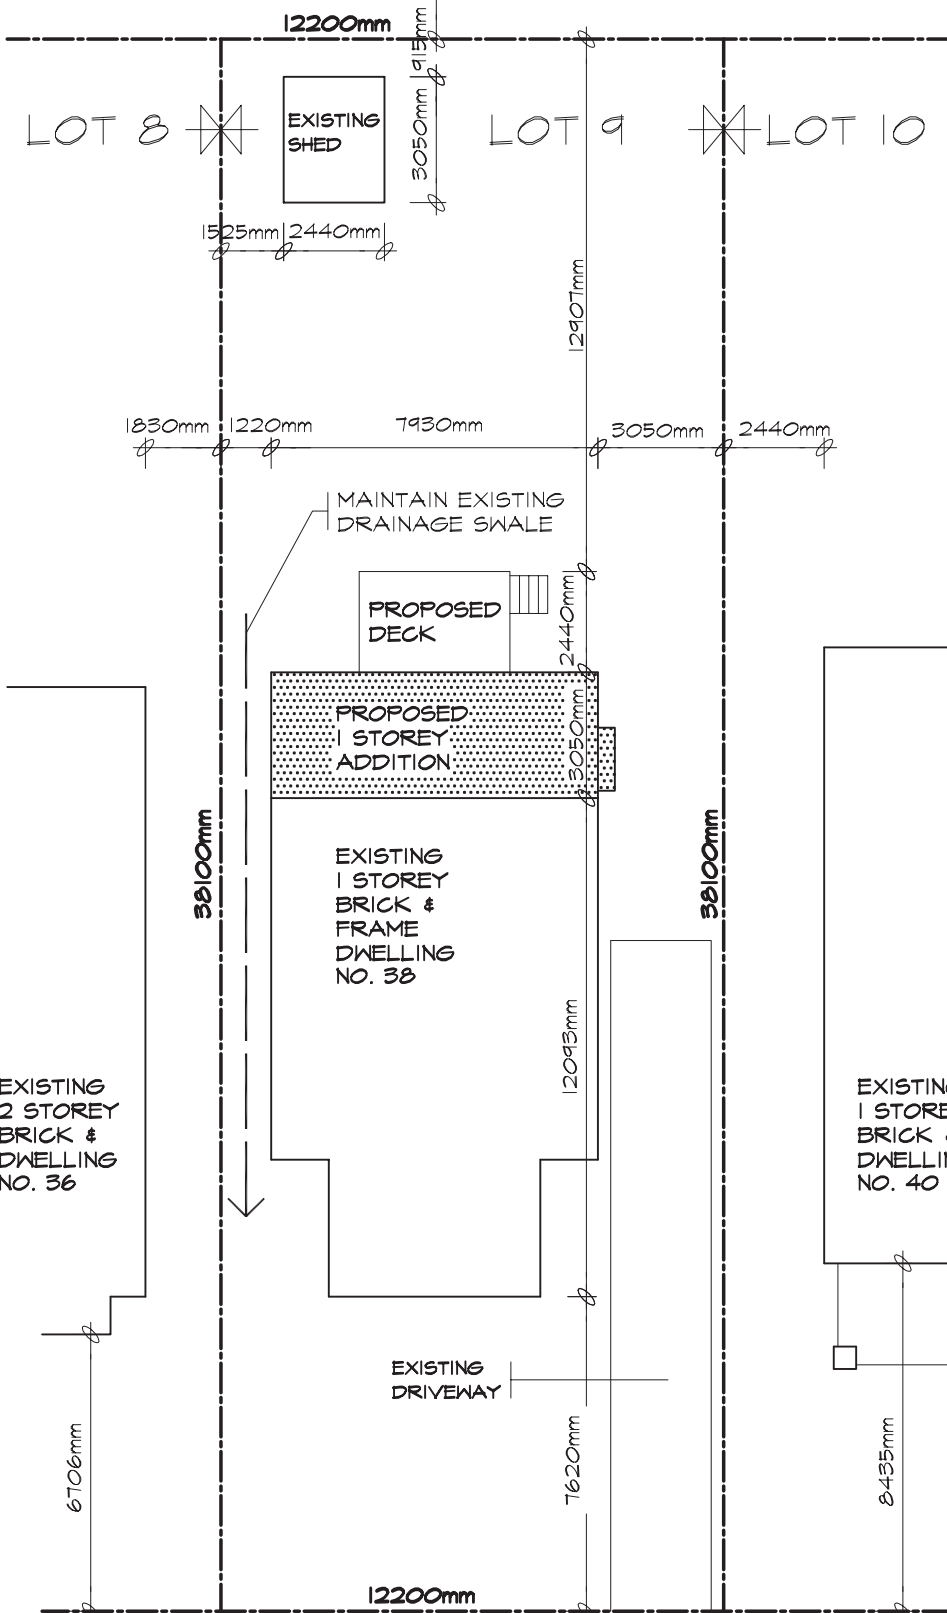

SITE PLAN

SCALE 1:200

SKETCH OF SURVEY OF LOT 9
 REG.'D PLAN 4220
 CITY OF TORONTO
 B.C. TRANSIT. O.L.S.
 DECEMBER 31ST, 1999

KHALMUR CRESCENT

ZONING	LOT NO:		PLAN NO:	LOT AREA			LOT FRONTAGE		LOT DEPTH
R2 Z0.6	LOT 9		4220	580.64m ²			12200mm		38110mm
DESCRIPTION	EXISTING	ADDITION	TOTAL	%	ALLOWED	%	SETBACKS	EXISTING	PROPOSED
LOT COVERAGE	86.52m ²	24.15m ²	110.65m ²	19.0	-----		FRONT YARD	7620mm	7620mm
GROSS FLOOR AREA	86.52m ²	24.15m ²	110.65m ²	19.0	348.39m ²	60.0	REAR YARD	18390mm	12907mm
LANDSCAPED AREA	-----	-----	-----		-----		INTERIOR SIDE (east)	3050mm	3050mm
NO. OF STORIES	1 STOREY 4550mm	1 STOREY 4550mm	1 STOREY 4550mm		10000mm		INTERIOR SIDE (west)	1220mm	1220mm
WIDTH	7930mm	7930mm	7930mm		-----		EXTERIOR	-----	-----
DEPTH	12093mm	3050mm	15143mm		17000mm				
PARKING	-----	-----	-----		-----				

NOTE: ZONING RESTRICTIONS VARY IN EVERY MUNICIPALITY. CONTACT YOUR LOCAL MUNICIPAL OFFICE FOR SPECIFIC SETBACKS AND OTHER LIMITATIONS IN YOUR AREA.

**LMCBO
STANDARD
DETAILS**



TITLE
SAMPLE DRAWING SITE PLAN

NOTE: UNDER THE BUILDING CODE ACT, THE LOCAL MUNICIPALITY IS THE AUTHORITY HAVING JURISDICTION FOR ENFORCING THE ACT AND IT'S REGULATIONS. IT IS THE RESPONSIBILITY OF THE OWNER/DESIGNER TO ENSURE THAT ALL DESIGNS SUBMITTED FOR A PERMIT ARE IN ACCORDANCE WITH THE BUILDING CODE ACT, BUILDING CODE AND ANY OTHER APPLICABLE LAW.

DWG. NO.

A03a

2012

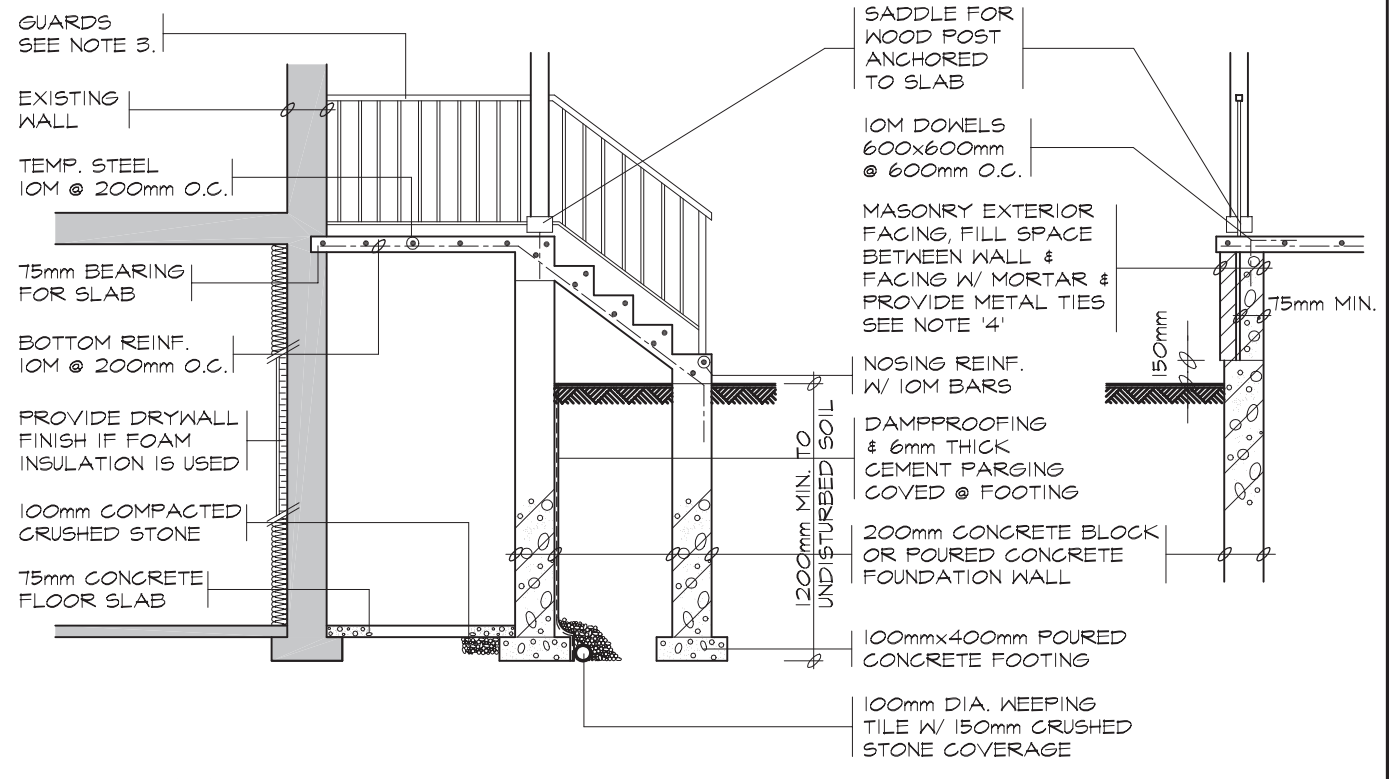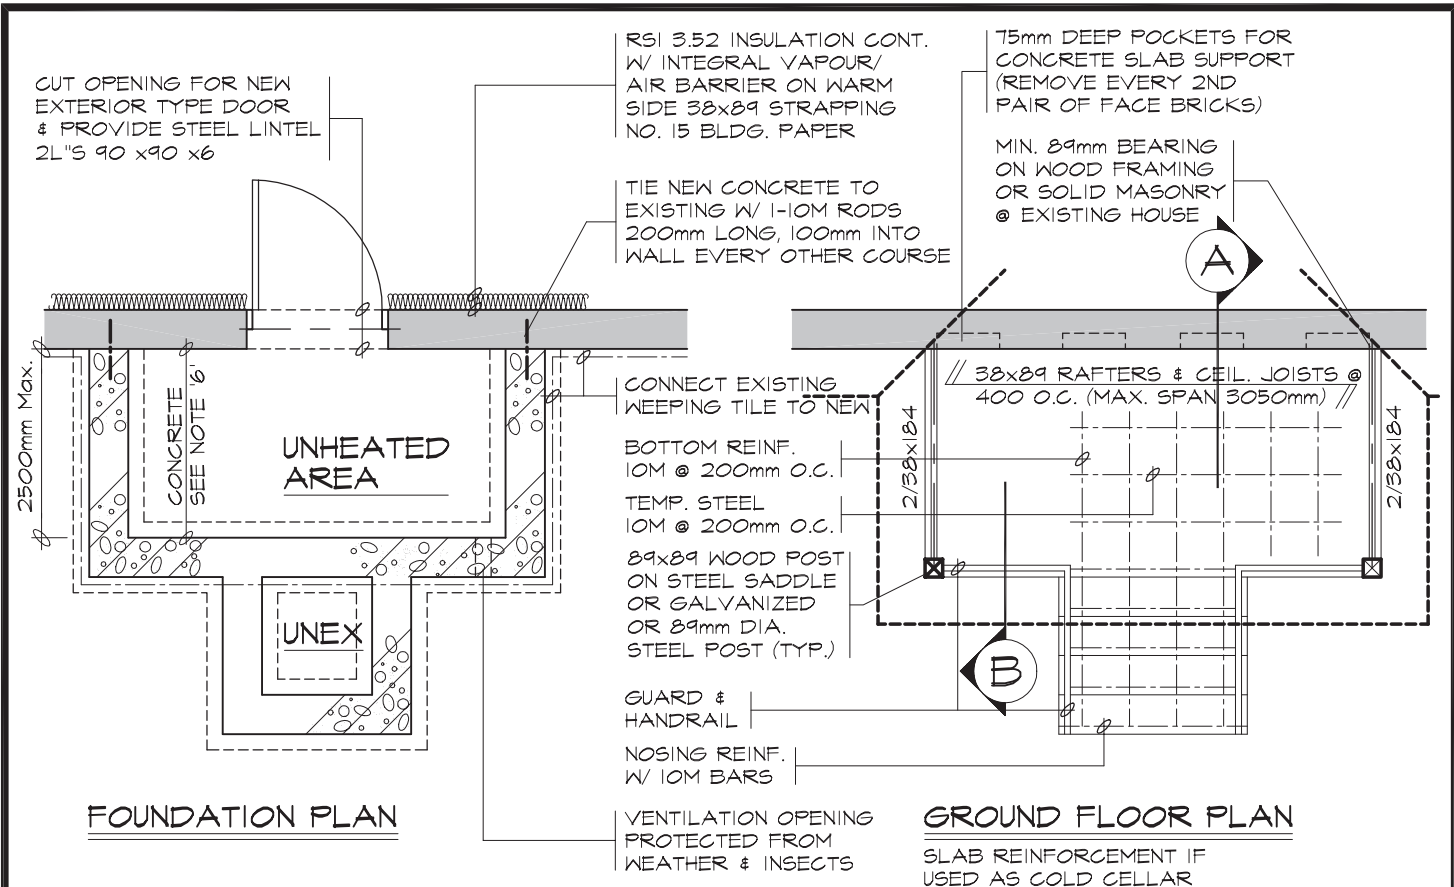

GENERAL NOTES

1. EXTERIOR STAIRS
 125mm - 200mm RISE
 210mm - 355mm RUN
 235mm - 355mm TREAD
 STEPS ARE TO BE UNIFORM THROUGHOUT FLIGHT
2. HANDRAILS
 ARE REQUIRED WHERE STEPS HAVE MORE THAN 3 RISERS. HANDRAIL HEIGHT 865mm - 965mm
3. GUARDS
 ARE REQUIRED AROUND CONCRETE SLAB IF MORE THAN 600mm ABOVE GRADE & ON BOTH SIDES OF STAIRS
 MINIMUM 900mm HIGH FOR STAIRS
 MINIMUM 900mm HIGH FOR PORCHES UP TO 1800mm ABOVE GRADE.
 MINIMUM 1070mm HIGH FOR GREATER HTS.
 MAXIMUM 100mm BETWEEN PICKETS AND NO MEMBER DESIGNED TO FACILITATE CLIMBING BETWEEN 140mm & 900mm
4. MASONRY TIES
 WHEN BRICK FACING IS USED ABOVE GROUND LEVEL, PROVIDE 0.76mm THICK & 22mm WIDE CORROSION RESISTANT METAL TIES @ 600mm HORIZ. & 500mm VERTICAL
5. FOUNDATION WALLS (LESS THAN 3M IN HEIGHT)
 THICKNESS OF UNREINFORCED FOUNDATION WALLS LATERALLY SUPPORTED AT THE TOP ARE DEPENDANT UPON HEIGHT OF FINISH GRADE ABOVE BASEMENT FLOOR
 UNIT MASONRY THICKNESS 190mm - MAX. HEIGHT 1200mm
 UNIT MASONRY THICKNESS 240mm - MAX. HEIGHT 1800mm
 UNIT MASONRY THICKNESS 290mm - MAX. HEIGHT 2200mm
6. CONCRETE
 MINIMUM CONCRETE STRENGTH SHALL BE 32Mpa W/ 5%-8% AIR ENTRAINMENT
 CONCRETE SLAB THICKNESS 125mm
 PROVIDE MIN. 30mm CLEAR CONCRETE COVER TO REINFORCING BARS

**LMCBO
STANDARD
DETAILS**

TITLE **CONCRETE PORCH & COLD CELLAR
PLANS, SECTIONS & NOTES**

DWG. NO.

NOTE: UNDER THE BUILDING CODE ACT, THE LOCAL MUNICIPALITY IS THE AUTHORITY HAVING JURISDICTION FOR ENFORCING THE ACT AND IT'S REGULATIONS. IT IS THE RESPONSIBILITY OF THE OWNER/DESIGNER TO ENSURE THAT ALL DESIGNS SUBMITTED FOR A PERMIT ARE IN ACCORDANCE WITH THE BUILDING CODE ACT, BUILDING CODE AND ANY OTHER APPLICABLE LAW.

DO2

2012

Excavation and Backfill

- Excavation shall be undertaken in such a manner so as to prevent damage to existing structures, adjacent property and utilities
- The topsoil and vegetable matter in unexcavated areas under a building shall be removed. The bottom of excavations for foundations shall be free of all organic material
- If termites are known to exist, all stumps, roots and wood debris shall be removed to a minimum depth of 300mm in excavated areas under a building, and the clearance between untreated structural wood elements and the ground shall be no less than 450mm
- Backfill within 600mm of the foundation walls shall be free of deleterious debris and boulders over 250mm in diameter

Dampproofing and Drainage

- In normal soil conditions, the exterior surfaces of foundation walls enclosing basements and crawl spaces shall be dampproofed. Where hydrostatic pressure occurs, a waterproofing system is required
- Masonry foundation walls shall be parged with 6mm of mortar covered over the footing prior to dampproofing
- 100mm dia. foundation drains shall be laid on level, undisturbed ground adjacent to the footings at or below the top of the basement slab or crawl space floor, and shall be covered with 150mm of crushed stone. Foundation drains shall drain to a storm sewer, drainage ditch, dry well or sump
- Window wells shall be drained to the footing level or to a ditch or sump pump.
- Downspouts not directly connected to a storm sewer shall have extensions to carry water away from the building, and provisions shall be made to prevent soil erosion
- Concrete slabs in attached garages shall be sloped to drain to the exterior
- The building site shall be graded so that surface, sump and roof drainage will not accumulate at or near the building and will not adversely affect adjacent properties

Footings

- minimum 15MPa poured concrete
- minimum 1200mm below finished grade
- Footings shall be founded on natural undisturbed soil, rock or compacted granular fill with minimum bearing capacity of 75kPa
100kPa for ICF

Footing Size

Floors Supported	Supporting Ext. Wall	Supporting Int. Wall	Column Area
1	250mm	200mm	0.40m ²
2	350mm	350mm	0.75m ²
3	450mm	500mm	1.00m ²

- Increase exterior footing width by 65mm for each storey of brick veneer supported, by 130mm for each storey of masonry and by 150mm for ICF
- Increase interior footing width by 100mm for each storey of masonry above footing, and by 100mm for each 2700mm of wall height above 5500mm
- The projection of an unreinforced footing beyond the wall supported shall not be greater than its thickness
- Column area based on max. 3000mm spacing

Step Footings

- 600mm max. rise
600mm min. run

Foundation Walls

- To be poured concrete, unit masonry, ICF or preserved wood (see drawings for type and thickness)
- Dampproofing shall be a heavy coat of bituminous material.
- Foundation wall to extend minimum 150mm above finished grade or 200mm for cladding. adversely affected by moisture.
- A drainage layer is required on the outside of a foundation wall where the interior insulation extends more than 900mm below exterior grade. A drainage layer shall consist of
 - Min. 19mm mineral fibre insulation with min. Density of 57 kg/m³
 - Min. 100mm of free drainage granular material, or
 - An approved system which provides equivalent performance
- Foundation walls shall be braced or have the floor joists installed before backfilling

Concrete Floor Slabs

- Garage, carport and exterior slabs and exterior steps shall be 32MPa concrete with 5-8% air entrainment
- Basement slab 25MPa concrete, minimum 75mm thick, placed on a minimum 100mm of coarse, clean, granular material
- All fill other than coarse clean material placed beneath concrete slabs shall be compacted to provide uniform support

Masonry Walls

- Where constructed of 90mm brick, wall shall be bonded with a header course every 600mm o/c vertically and horizontally and 900mm o/c for block or tile.
- Provide 50mm solid masonry, concrete filled top course or continuous 38x89 wood plate under all roof and floor framing members
- Provide 190mm solid masonry under beams and columns
- Masonry wall to be tied to each tier of joists with 40mm x 4.76mm corrosion resistant steel straps, keyed minimum 100mm into masonry. When joists are parallel to wall, ties are to extend across at least 3 joists @ 2000mm o.c.
- Inside of wall to be parged and covered with No. 15 breather-type asphalt paper
- For reduced foundation walls to allow a brick facing while maintaining lateral support, tie minimum 90mm brick to minimum 90mm back-up block with corrosion resistant ties at least 17.8mm² in cross sectional area, spaced 200mm vertically and 900mm horizontally, with joints completely filled with mortar
- Masonry over openings shall be supported on corrosion resistant or prime painted steel lintels with a minimum of 150mm end bearing

Masonry Veneer

- Minimum 70mm thick if joints are not raked and 90mm thick if joints are raked
- Minimum 25mm air space to sheathing
- Provide weep holes @ 800mm o.c. at the bottom of the cavity and over doors and windows
- Direct drainage through weep holes with 0.5mm poly flashing extending minimum 150mm up behind the sheathing paper
- Veneer ties minimum 0.76mm thick x 22mm wide corrosion resistant straps spaced @ 500mm vertically and 600mm horizontally
- Fasten ties with corrosion resistant 3.18mm diameter screws or spiral nails which penetrate at least 30mm into studs